


MINIDRAGON HEATER- Installation Diagram for Separate Control

NOTE:
Do not place the sensors too near to air ventilation (not under 1000mm) or not under 500mm from air ventilation, which is directed away from sensors.

Minimum Safety Distances


	A	B	C
MN-23NS-DRF	60	50	90
MN-30NS-DRF	60	50	90
MN-36NS-DRF	60	50	90

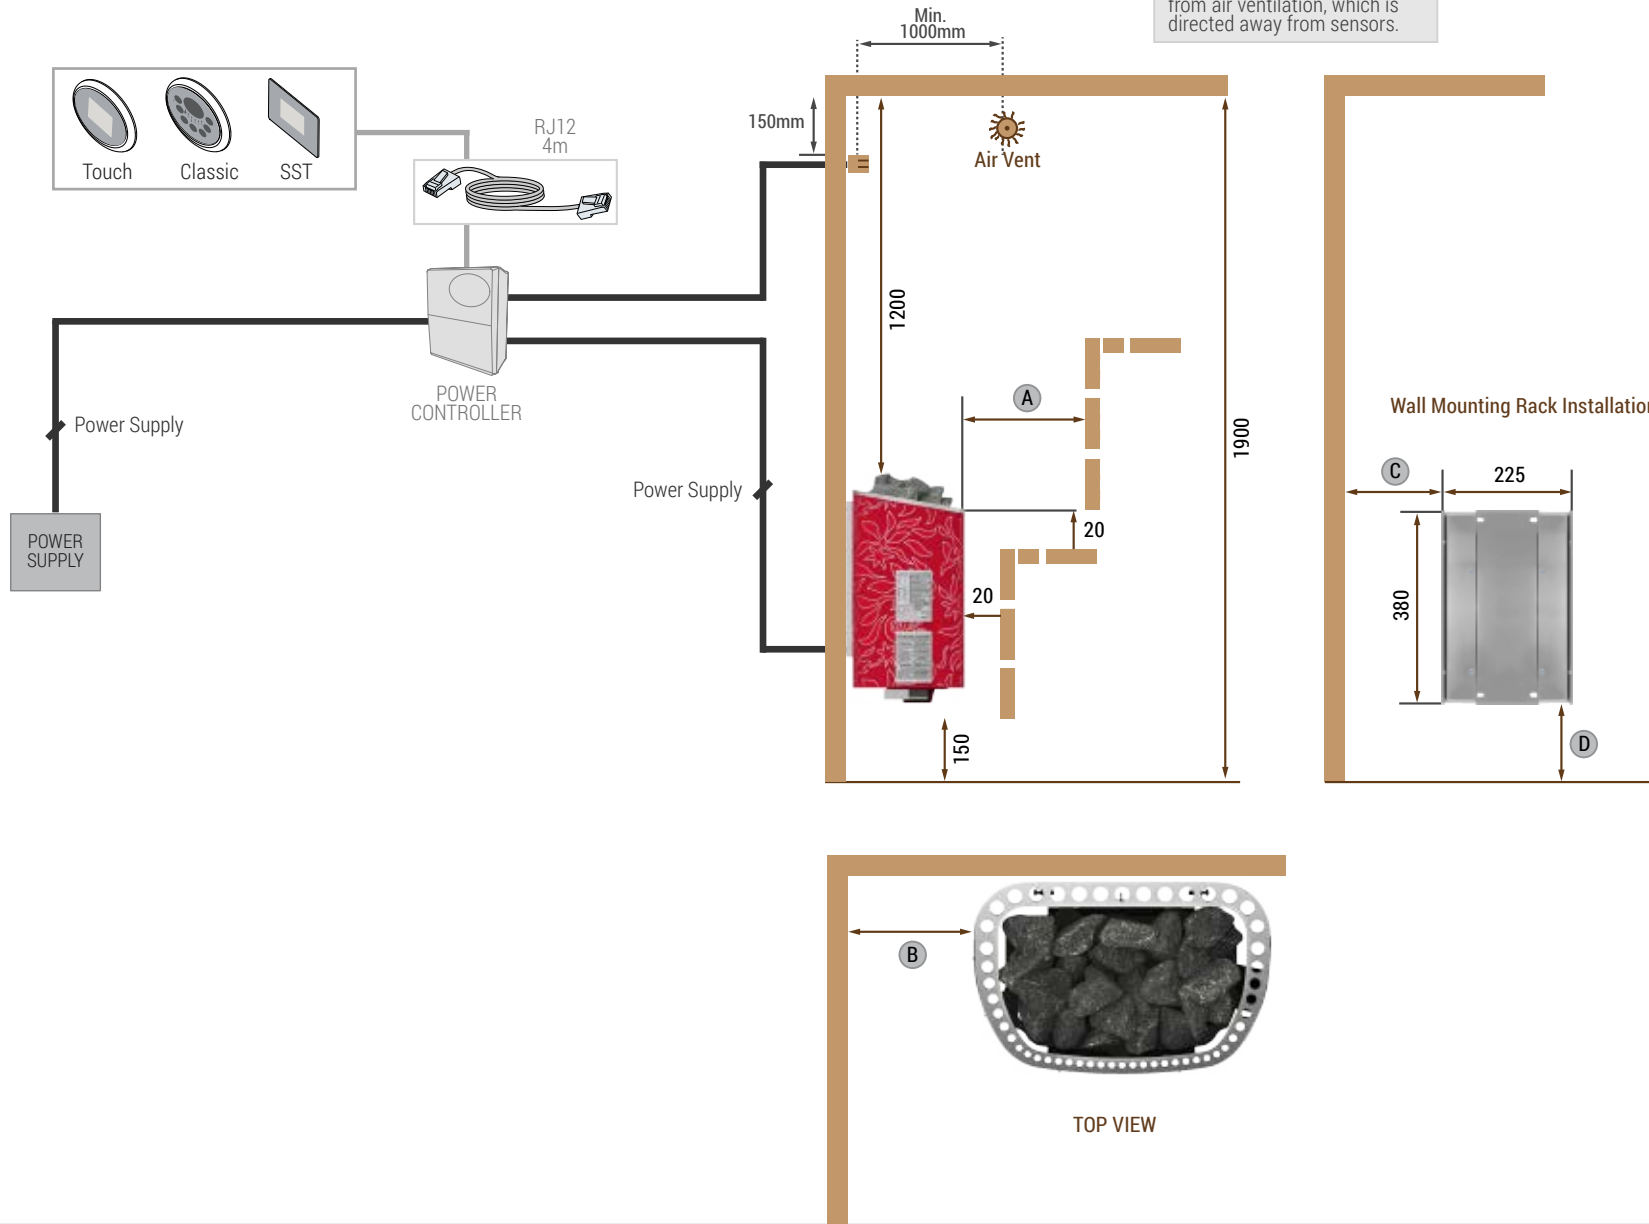

MINIDRAGON HEATER- Installation Diagram for Built-in Control

Minimum Safety Distances

	A	B	C
MN-23NB-DRF	100	100	140
MN-30NB-DRF	100	100	140
MN-36NB-DRF	100	100	140

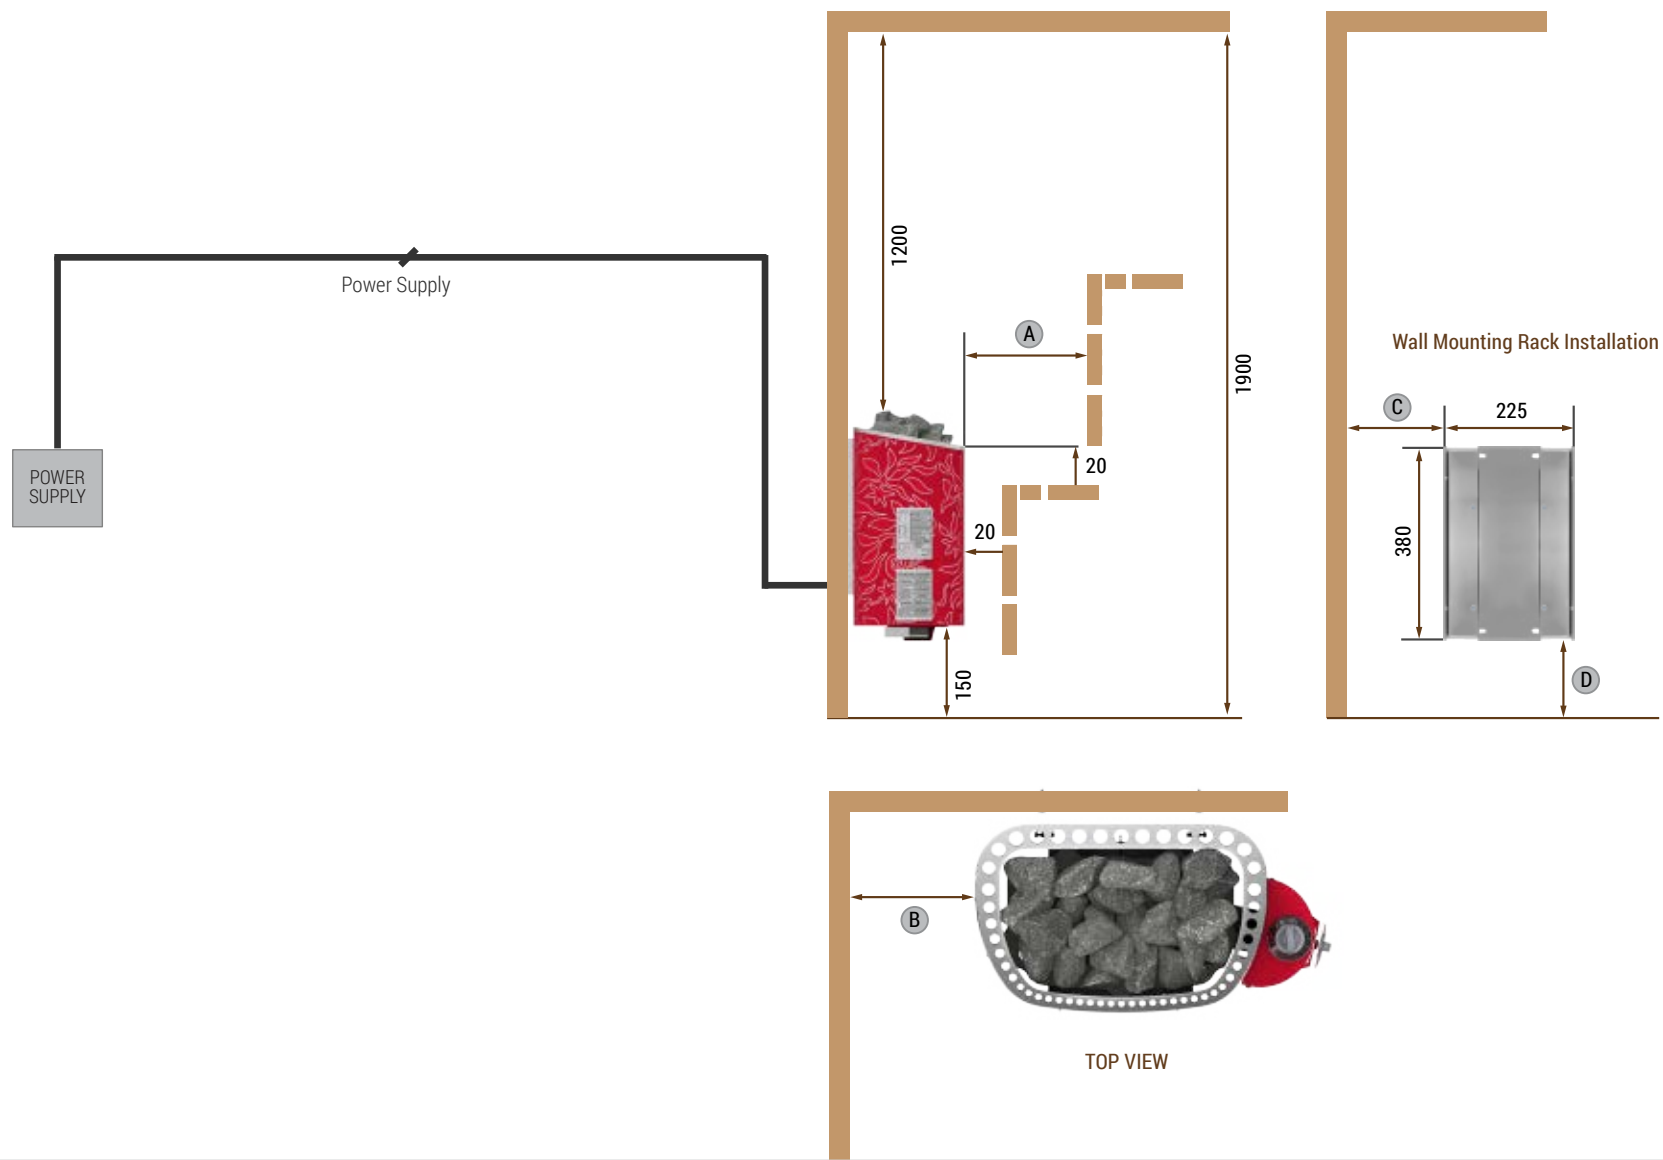

TOP VIEW